


700 gpm DURING SAFE  
CLEAN DRINKING WATER  
PROJECT WORK

700 GALLONS PAR MINUTE  
PENDANT LES TRAVAUX DU PROJET  
EAU POTABLE SAIN ET PROPRE

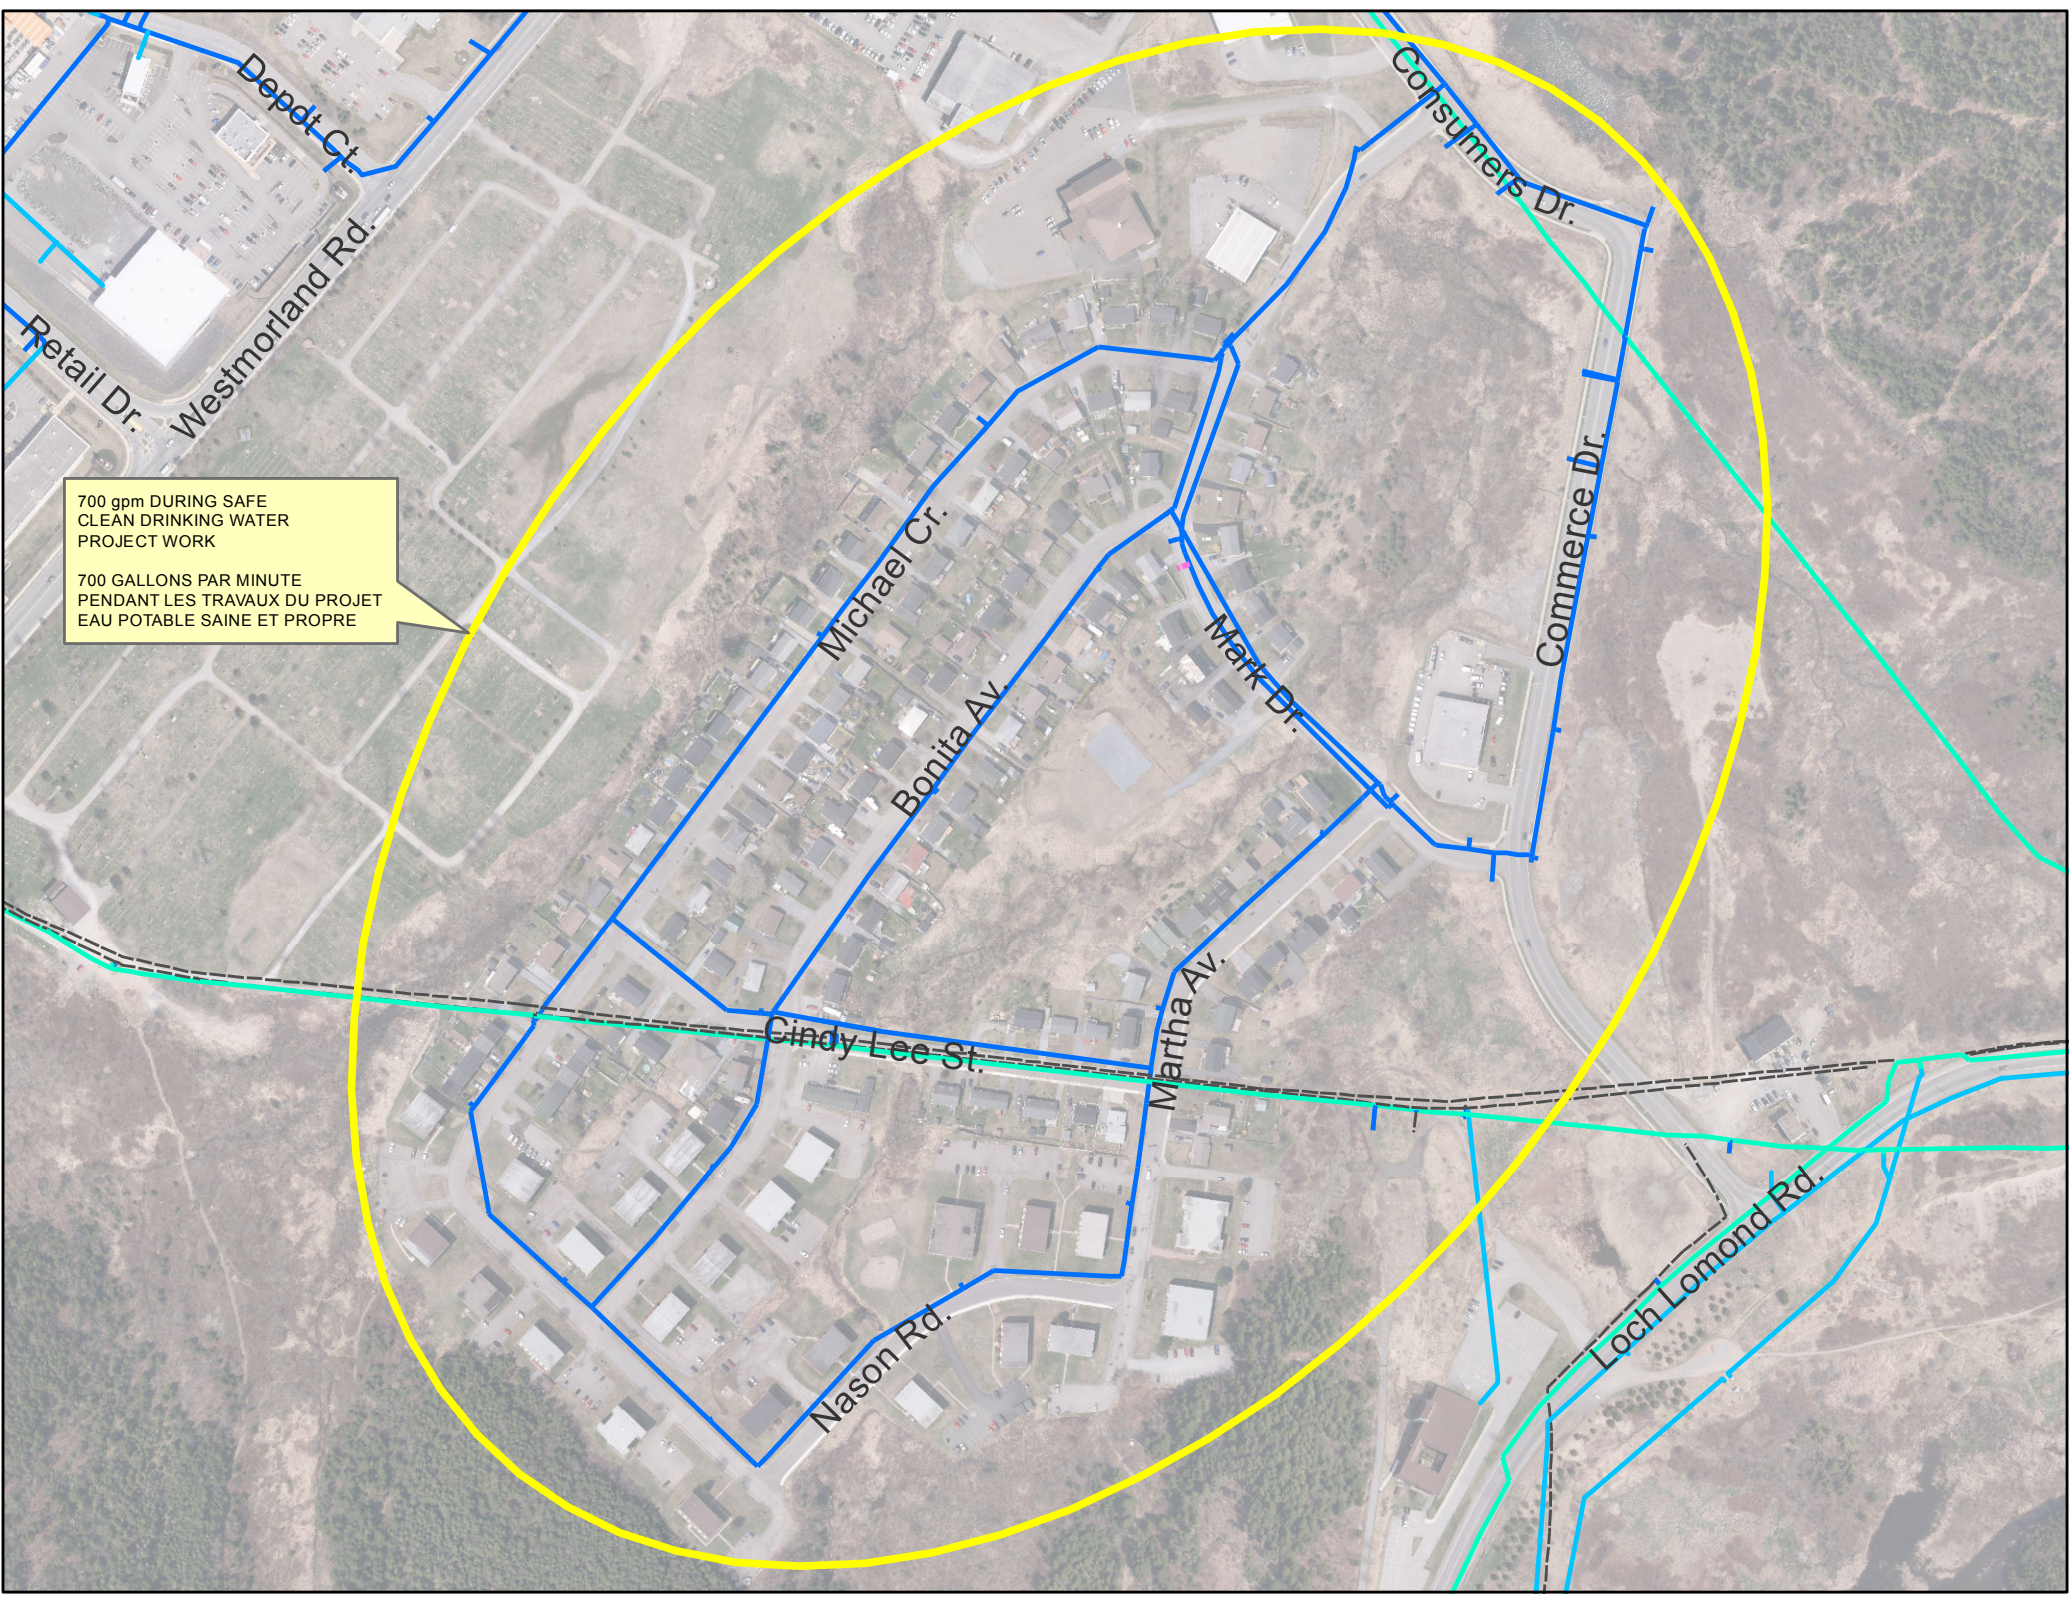

Depdt Ct.

Retail Dr.

Westmorland Rd.

Consumers Dr.

Michael Cr.

Bonita Av.

Mark Dr.

Commerce Dr.

Cindy Lee St.

Martha Av.

Nason Rd.

Loch Lomond Rd.